Test Report

SEMTECH ELECTRONICS LIMITED
12-18 BAIYE CHENG ROAD,SHANGTUN INDUSTRIAL ZONE,LIAOBU,DONGGUAN,GUANGDONG,PR CHINA

The following sample(s) was/were submitted and identified on behalf of the clients as :
DO-214

SGS Job No.	:	11569355 - GZ
SGS Internal Reference No.	:	17.5
Date of Sample Received	:	16 Jan 2009
Testing Period	:	16 Jan 2009 - 02 Feb 2009
Test Requested	:	Selected test(s) as requested by client.
Test Method	:	Please refer to next page(s).
Test Results	:	Please refer to next page(s).
Conclusion	:	A: Based on the performed tests on submitted sample(s), the results **comply with** the RoHS Directive 2002/95/EC and its subsequent amendments.

Signed for and on behalf of
SGS-CSTC Ltd.

Huang Fang, Sunny
Sr. Engineer

SGS-CSTC Standards Technical Services Co., Ltd.
Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)

Test Results:

ID for specimen 1 : CAN09-002413.005
Description for specimen 1 : Black body (mixed)

A: RoHS Directive 2002/95/EC

Test Item(s)	Unit	Test Method (Reference)	Result	MDL	Limit
Cadmium (Cd)	mg/kg	IEC 62321:2008, ICP-OES	N.D.	2	100
Lead (Pb)	mg/kg	IEC 62321:2008, ICP-OES	17032<1>	2	1000
Mercury (Hg)	mg/kg	IEC 62321:2008, ICP-OES	N.D.	2	1000
Hexavalent Chromium (CrVI) by alkaline extraction	mg/kg	IEC 62321:2008, UV-Vis	N.D.	2	1000
Sum of PBBs	mg/kg	-	N.D.	-	1000
Monobromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Dibromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Tribromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Tetrabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Pentabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Hexabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Heptabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Octabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Nonabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Decabromobiphenyl	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Sum of PBDEs	mg/kg	-	N.D.	-	1000
Monobromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Dibromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Tribromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Tetrabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Pentabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Hexabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Heptabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Octabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Nonabromodiphenyl ether	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	
Decabromodiphenyl ether ##	mg/kg	IEC 62321:2008, GC-MS	N.D.	5	

Note:
1. mg/kg = ppm
2. N.D. = Not Detected (< MDL)
3. MDL = Method Detection Limit
4. ## = The exemption of DecaBDE in polymeric application according 2005/717/EC was overruled by the European Court of Justice by its decision of 01.04.2008. Subsequently DecaBDE is included in the sum of PBDE after 01.07.2008
5. "-" = Not regulated

SGS-CSTC Standards Technical Services Co., Ltd. Guangzhou Branch (Guangzhou TESTING SERVICES Chemical Laboratory)
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com

ID for specimen 2 : CAN09-002413.006
Description for specimen 2 : Silvery metal pin

A: RoHS Directive 2002/95/EC

Test Item(s)	Unit	Test Method (Reference)	Result	MDL	Limit
Cadmium (Cd)	mg/kg	IEC 62321:2008, ICP-OES	N.D.	2	100
Lead (Pb)	mg/kg	IEC 62321:2008, ICP-OES	N.D.	2	1000
Mercury (Hg)	mg/kg	IEC 62321:2008, ICP-OES	N.D.	2	1000
Hexavalent Chromium (CrVI) by boiling water extraction	-	IEC 62321:2008, UV-Vis	Negative	◇	#

Note:
1. mg/kg = ppm
2. N.D. = Not Detected (< MDL)
3. MDL = Method Detection Limit
4. ◇ = Spot-Test:
   Negative = Absence of CrVI coating, Positive = Presence of CrVI coating;
   (The tested sample should be further verified by boiling-water-extraction method if the spot test result is negative or cannot be confirmed.)
   Boiling-water-extraction:
   Negative = Absence of CrVI coating
   Positive = Presence of CrVI coating; the detected concentration in boiling-water-extraction solution is equal or greater than 0.02 mg/kg with 50 cm² sample surface area.
   Storage conditions and production date of the tested sample are unavailable and thus results of Cr(VI) represent status of the sample at the time of testing.
5. # = Positive indicates the presence of CrVI on the tested areas.
   Negative indicates the absence of CrVI on the tested areas.
6. "-" = Not regulated

B:Heavy metal(s)

Test Item(s)	Unit	Test Method (Reference)	Result	MDL
Hexavalent Chromium (CrVI) by boiling water extraction	µg/cm²	JIS H8625-1993, UV-Vis	N.D.	0.02

Note:
1. mg/kg = ppm
2. N.D. = Not Detected (< MDL)
3. MDL = Method Detection Limit

SGS-CSTC Standards Technical Services Co., Ltd.
Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国・广州・经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)

Remark1: As requested by client, the testing of specimen 1 was conducted as whole / part sample, for the sample can't be disjointed.

Remark<1>: According to the declaration from client, the source of Lead in the specimen 1 could be from the high melting temperature type solder, while Lead in high melting temperature type solders is exempted by RoHS reglatory (Directive 2002/95/EC of the European Parliament and of the council of 27 January 2003).

SGS-CSTC Standards Technical Services Co., Ltd.
Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)

ATTACHMENTS

Testing Flow Chart

1) Name of the person who made measurement: Bowen Chen
2) Name of the person in charge of measurement: Adams Yu
3) These samples were dissolved totally by pre-conditioning method according to below flow chart (Cr^{6+} test method excluded) .

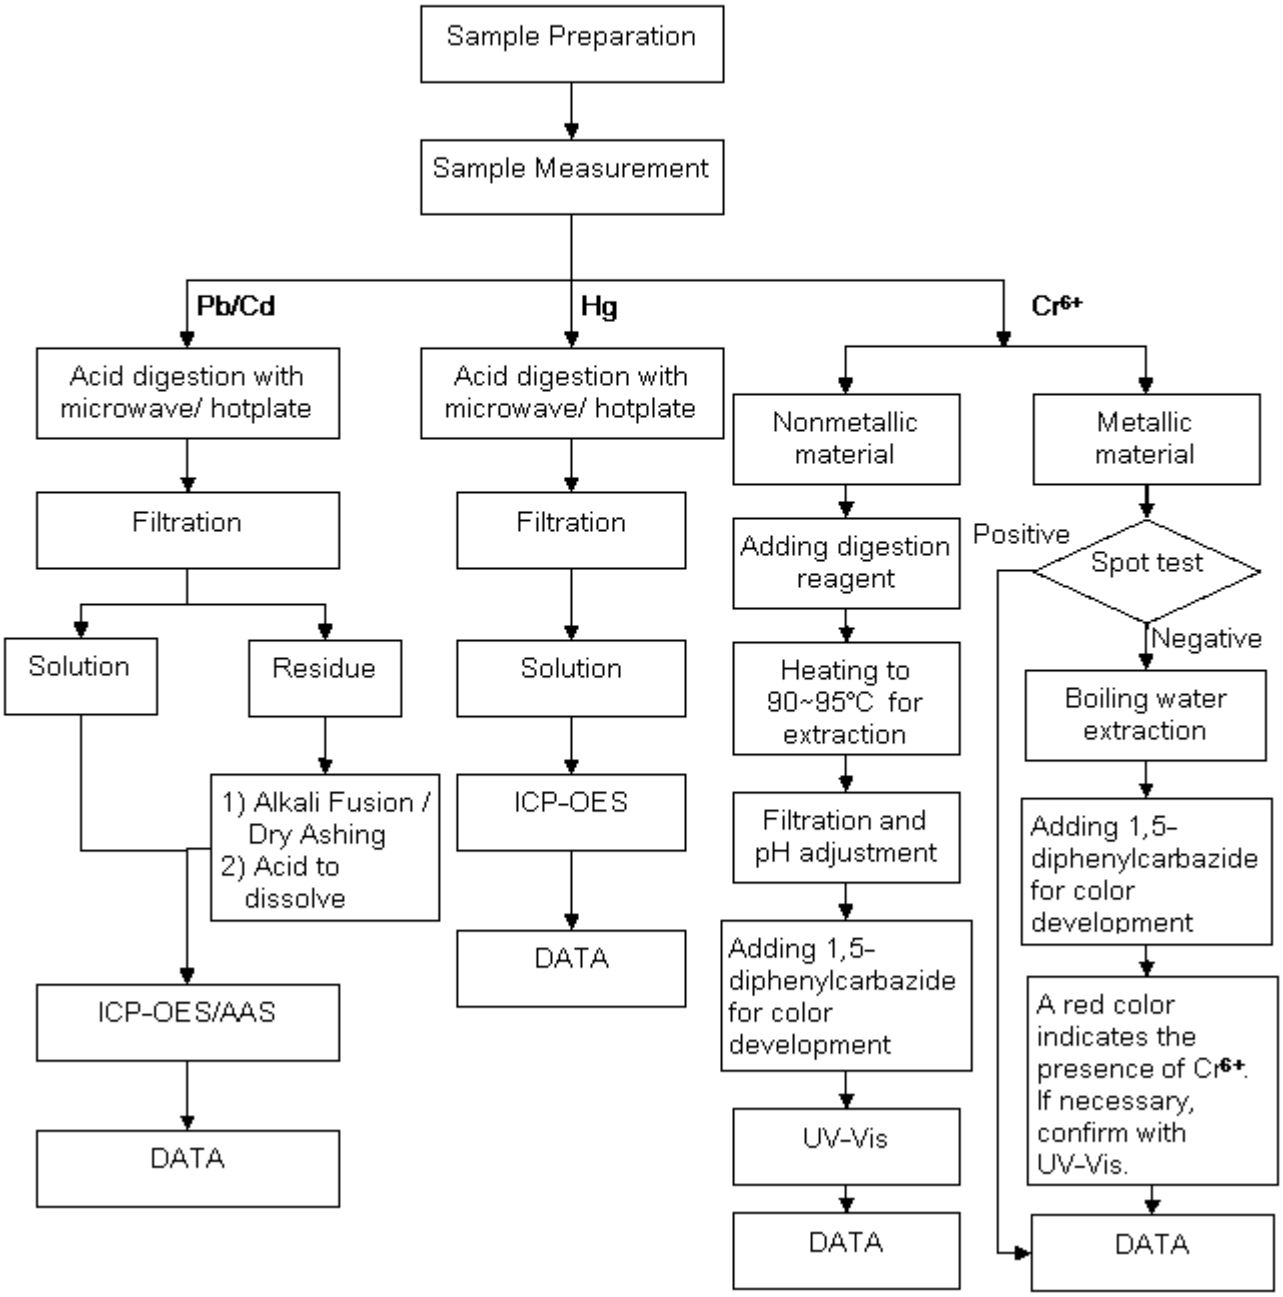

ATTACHMENTS

Testing Flow Chart

1) Name of the person who made measurement: Bowen Chen
2) Name of the person in charge of measurement: Adams Yu

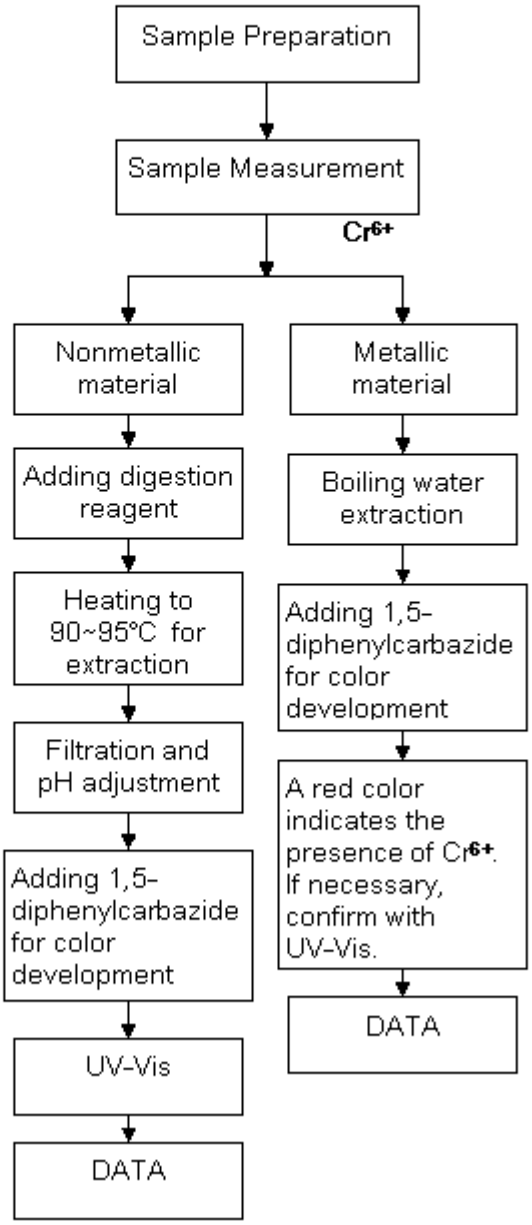

SGS-CSTC Standards Technical Services Co., Ltd. Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)

Testing Flow Chart

1) Name of the person who made measurement: Lina Tang
2) Name of the person in charge of measurement: Tina Zhao

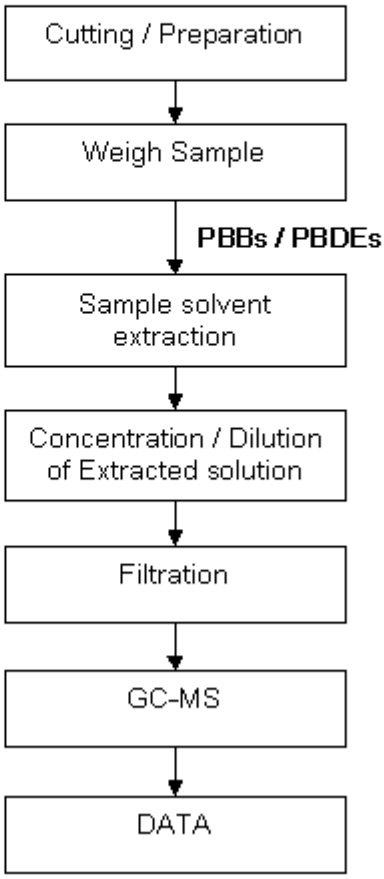

SGS-CSTC Standards Technical Services Co., Ltd.
Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)

Sample photo:

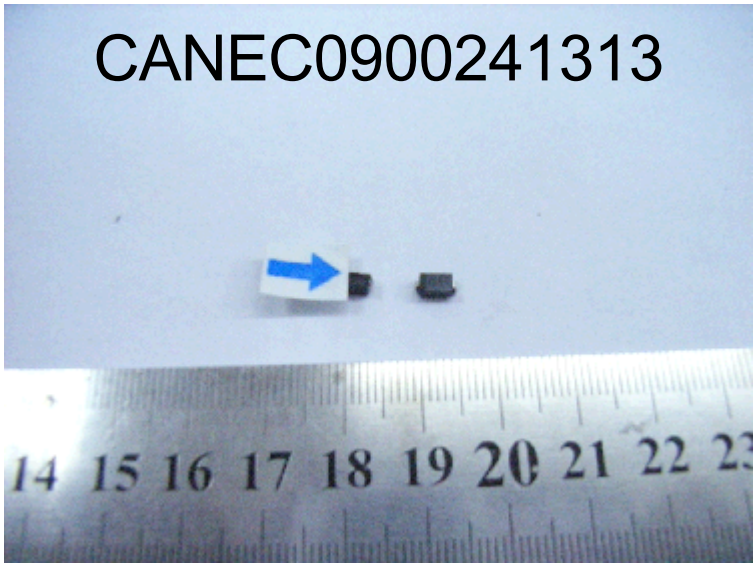

CAN09-002413.005

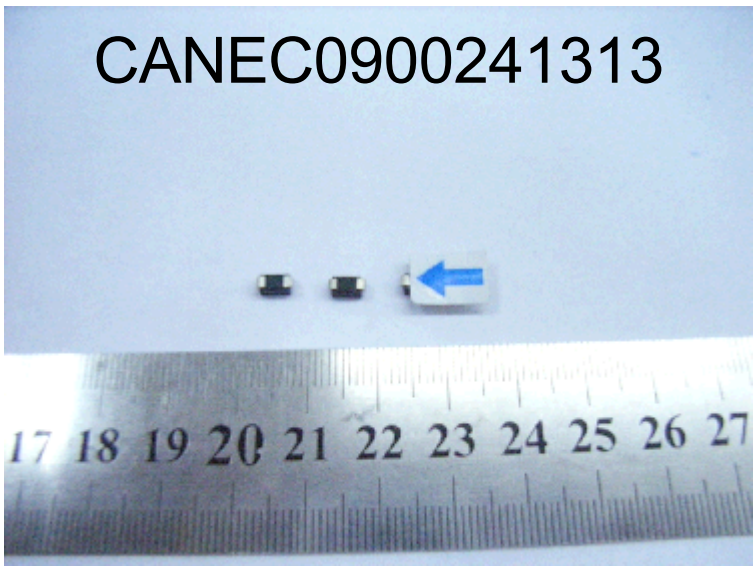

CAN09-002413.006

SGS authenticate the photo on original report only

*** End of Report ***

SGS-CSTC Standards Technical Services Co., Ltd.
Guangzhou Branch Testing Service Chemical Laboratory.
198 Kezhu Road, Scientech Park Guangzhou Economic & Technology Development District. Guangzhou, China 510663 t (86-20)82155555 f (86-20)82075113 www.cn.sgs.com
中国·广州·经济技术开发区科学城科珠路198号 邮编: 510663 t (86-20)82155555 f (86-20)82075113 e sgs.china@sgs.com
Member of the SGS Group (SGS SA)